
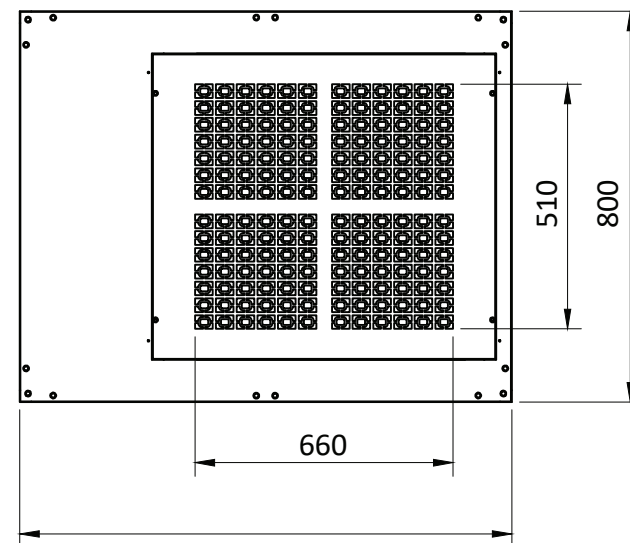
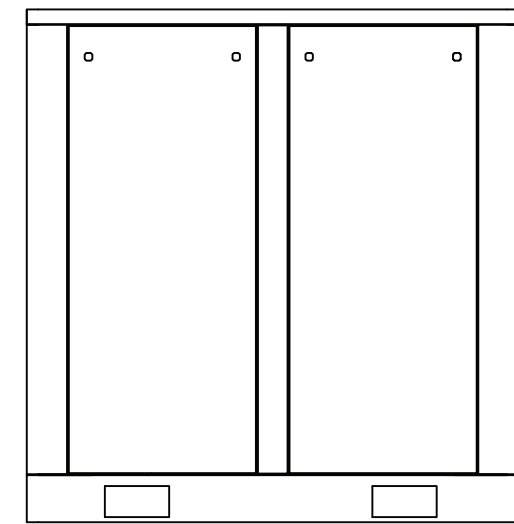
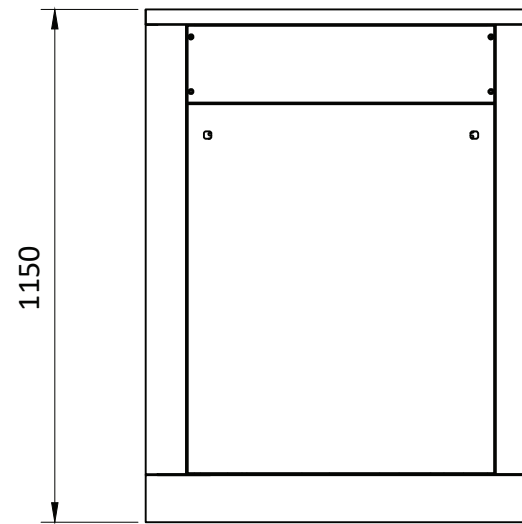
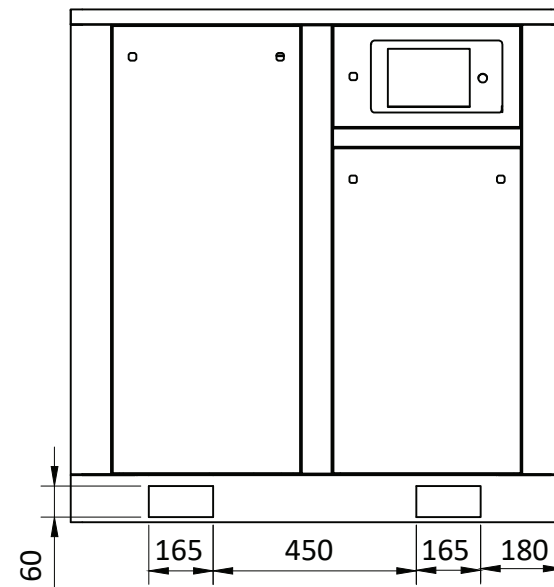


| Tolerance grade | Unmarked tolerance |       |      |        |         |          |           |
|-----------------|--------------------|-------|------|--------|---------|----------|-----------|
|                 | 0.5-3              | 3-6   | 6-30 | 30-120 | 120-400 | 400-1000 | 1000-3000 |
| Precision F     | ±0.05              | ±0.05 | ±0.1 | ±0.2   | ±0.3    | ±0.3     | ±0.5      |
| Medium M        | ±0.1               | ±0.1  | ±0.2 | ±0.3   | ±0.5    | ±0.8     | ±1.2      |
| Coarse C        | ±0.2               | ±0.3  | ±0.5 | ±0.8   | ±1.2    | ±2       | ±3        |

3.2

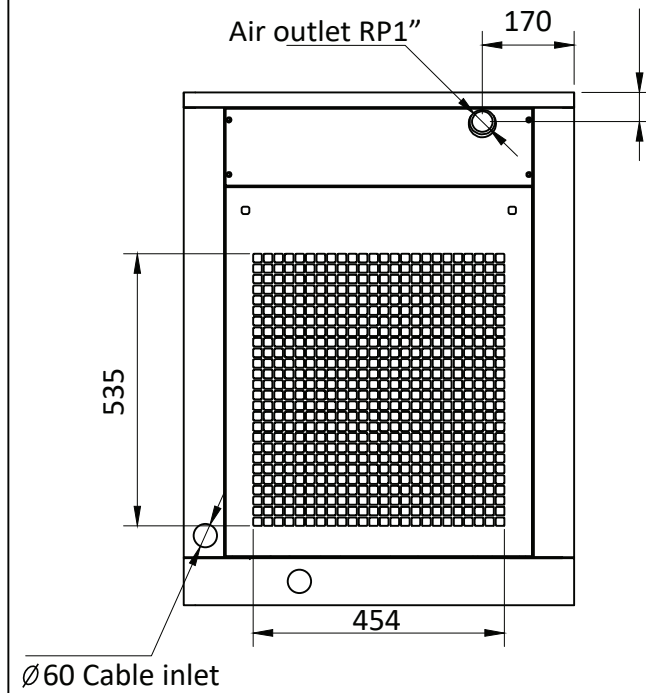

Technical requirements:

- 1.All dimensional tolerance:  $\pm 3\text{mm}$
- 2.The reserved length of the power cable not less than 1m
- 3.The space of surrounding of air compressor should reserve at least 1m, and the space in front of the air compressor controller should reserve at least 1.5m
- 4.No force or torque shall be generated to the compressor after install the external pipelines
- 5.Do not use plastic pipes in downstream pipelines
- 6.After the compressor is installed, seal the forklift hole with the cover plate
- 7.When installing the exhaust pipe of the compressor, the pressure loss should be less than 6MMH<sub>2</sub>O
- 8.Power supply please follow the data in nameplate, must connect the ground